


# Area Type Averages

Building type: College/University. Building size: 100K to less than 250K. Shifts: 2

Area Type Averages				Normalized Weekly Lights On					Normalized Weekly Occupied					
Area Type	Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav	
Restroom	R	2	288	72.39	0.00	0.00	72.39	23.14	0.00	0.00	0.00	23.14	68.03%	
Hallway	H	3	271	147.77	0.00	0.00	147.77	72.45	0.00	0.00	0.00	72.45	50.97%	
Classroom	CR	1	1152	7.38	0.00	0.00	7.38	3.82	0.00	0.00	0.00	3.82	48.24%	
Janitor Closet	J	1	64	67.32	0.00	0.00	67.32	28.36	0.00	0.00	0.00	28.36	57.87%	
Copy Rm	C	1	34	73.32	0.00	0.00	73.32	39.96	0.00	0.00	0.00	39.96	45.50%	
Library	LI	7	427	126.91	0.00	0.00	126.91	47.84	0.00	0.00	0.00	47.84	62.30%	
Office	O	3	450	36.42	0.00	0.00	36.42	28.52	0.00	0.00	0.00	28.52	21.69%	
Lobby	LB	1	300	167.99	0.00	0.00	167.99	41.71	0.00	0.00	0.00	41.71	75.17%	
Building Average			7278	90.14			90.14	37.62			0.00	37.62	58.26%	

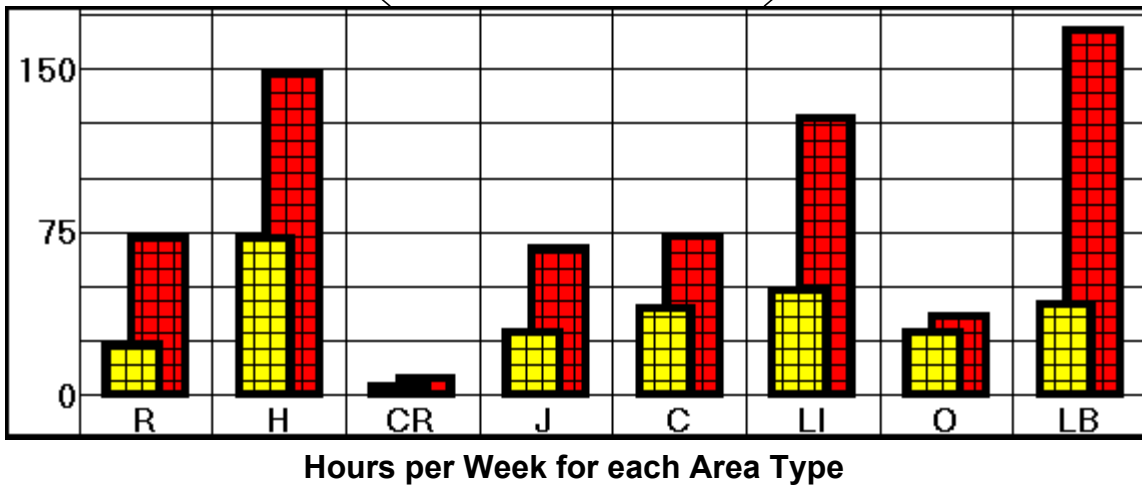

Data Logger Detail Building type:College/University. Building size:100K to less than 250K. Shifts:2 Page 1 of 1

All Loggers Listed			Hours Installed							Lights On					Occupied				
Logger	Area Type	Ty	Total	Peak	Off	Shldr 1	Shldr 2	Installed	Removed	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
23632	Classroom	CR	551.15	551.15	0.00	0.00	0.00	8/31/05 10:29 AM	9/23/05 9:37 AM	24.22	0.00	0.00	0.00	24.22	12.52	0.00	0.00	0.00	12.52
21865	Lobby	LB	551.15	551.15	0.00	0.00	0.00	8/31/05 10:31 AM	9/23/05 9:39 AM	551.13	0.00	0.00	0.00	551.13	136.83	0.00	0.00	0.00	136.83
20652	Hallway	H	551.10	551.10	0.00	0.00	0.00	8/31/05 10:25 AM	9/23/05 9:30 AM	509.92	0.00	0.00	0.00	509.92	250.75	0.00	0.00	0.00	250.75
22733	Restroom	R	551.10	551.10	0.00	0.00	0.00	8/31/05 10:28 AM	9/23/05 9:33 AM	335.18	0.00	0.00	0.00	335.18	124.72	0.00	0.00	0.00	124.72
23814	Office	O	551.08	551.08	0.00	0.00	0.00	8/31/05 10:22 AM	9/23/05 9:26 AM	266.23	0.00	0.00	0.00	266.23	205.33	0.00	0.00	0.00	205.33
21840	Restroom	R	551.12	551.12	0.00	0.00	0.00	8/31/05 10:37 AM	9/23/05 9:43 AM	139.70	0.00	0.00	0.00	139.70	27.07	0.00	0.00	0.00	27.07
20840	Hallway	H	551.15	551.15	0.00	0.00	0.00	8/31/05 10:33 AM	9/23/05 9:41 AM	469.17	0.00	0.00	0.00	469.17	232.20	0.00	0.00	0.00	232.20
21763	Office	O	551.12	551.12	0.00	0.00	0.00	8/31/05 10:35 AM	9/23/05 9:41 AM	77.50	0.00	0.00	0.00	77.50	75.30	0.00	0.00	0.00	75.30
22277	Janitor Closet	J	551.00	551.00	0.00	0.00	0.00	8/31/05 10:45 AM	9/23/05 9:44 AM	220.78	0.00	0.00	0.00	220.78	93.00	0.00	0.00	0.00	93.00
20869	Office	O	542.22	542.22	0.00	0.00	0.00	8/31/05 7:40 PM	9/23/05 9:52 AM	14.48	0.00	0.00	0.00	14.48	0.00	0.00	0.00	0.00	0.00
21483	Hallway	H	550.98	550.98	0.00	0.00	0.00	8/31/05 10:57 AM	9/23/05 9:55 AM	475.05	0.00	0.00	0.00	475.05	230.05	0.00	0.00	0.00	230.05
22716	Copy Rm	C	550.98	550.98	0.00	0.00	0.00	8/31/05 10:56 AM	9/23/05 9:54 AM	240.47	0.00	0.00	0.00	240.47	131.07	0.00	0.00	0.00	131.07
22297	Library	LI	550.88	550.88	0.00	0.00	0.00	8/31/05 11:12 AM	9/23/05 10:04 AM	415.17	0.00	0.00	0.00	415.17	228.97	0.00	0.00	0.00	228.97
22078	Library	LI	550.80	550.80	0.00	0.00	0.00	8/31/05 11:21 AM	9/23/05 10:08 AM	415.32	0.00	0.00	0.00	415.32	189.70	0.00	0.00	0.00	189.70
21968	Library	LI	550.92	550.92	0.00	0.00	0.00	8/31/05 11:16 AM	9/23/05 10:10 AM	415.33	0.00	0.00	0.00	415.33	152.08	0.00	0.00	0.00	152.08
21976	Library	LI	550.80	550.80	0.00	0.00	0.00	8/31/05 11:18 AM	9/23/05 10:05 AM	415.25	0.00	0.00	0.00	415.25	48.12	0.00	0.00	0.00	48.12
21133	Library	LI	550.87	550.87	0.00	0.00	0.00	8/31/05 11:15 AM	9/23/05 10:06 AM	415.38	0.00	0.00	0.00	415.38	7.57	0.00	0.00	0.00	7.57
21981	Library	LI	550.95	550.95	0.00	0.00	0.00	8/31/05 11:06 AM	9/23/05 10:02 AM	418.58	0.00	0.00	0.00	418.58	213.30	0.00	0.00	0.00	213.30
22668	Library	LI	550.95	550.95	0.00	0.00	0.00	8/31/05 11:05 AM	9/23/05 10:01 AM	417.87	0.00	0.00	0.00	417.87	258.43	0.00	0.00	0.00	258.43

All Loggers Listed			Load	Normalized Weekly Hours of Use					Normalized Weekly Hours of Occupancy					
Logger	Area Type	Ty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav
23632	Classroom	CR	1152	7.38	0.00	0.00	0.00	7.38	3.82	0.00	0.00	0.00	3.82	48.24%
21865	Lobby	LB	300	167.99	0.00	0.00	0.00	167.99	41.71	0.00	0.00	0.00	41.71	75.17%
20652	Hallway	H	320	155.45	0.00	0.00	0.00	155.45	76.44	0.00	0.00	0.00	76.44	50.83%
22733	Restroom	R	288	102.18	0.00	0.00	0.00	102.18	38.02	0.00	0.00	0.00	38.02	62.79%
23814	Office	O	960	81.16	0.00	0.00	0.00	81.16	62.60	0.00	0.00	0.00	62.60	22.87%
21840	Restroom	R	288	42.59	0.00	0.00	0.00	42.59	8.25	0.00	0.00	0.00	8.25	80.63%
20840	Hallway	H	300	143.01	0.00	0.00	0.00	143.01	70.78	0.00	0.00	0.00	70.78	50.51%
21763	Office	O	288	23.62	0.00	0.00	0.00	23.62	22.95	0.00	0.00	0.00	22.95	2.84%
22277	Janitor Closet	J	64	67.32	0.00	0.00	0.00	67.32	28.36	0.00	0.00	0.00	28.36	57.87%
20869	Office	O	102	4.49	0.00	0.00	0.00	4.49	0.00	0.00	0.00	0.00	0.00	00.00%
21483	Hallway	H	192	144.85	0.00	0.00	0.00	144.85	70.14	0.00	0.00	0.00	70.14	51.58%
22716	Copy Rm	C	34	73.32	0.00	0.00	0.00	73.32	39.96	0.00	0.00	0.00	39.96	45.50%
22297	Library	LI	576	126.61	0.00	0.00	0.00	126.61	69.83	0.00	0.00	0.00	69.83	44.85%
22078	Library	LI	384	126.68	0.00	0.00	0.00	126.68	57.86	0.00	0.00	0.00	57.86	54.33%
21968	Library	LI	384	126.65	0.00	0.00	0.00	126.65	46.38	0.00	0.00	0.00	46.38	63.38%
21976	Library	LI	384	126.66	0.00	0.00	0.00	126.66	14.68	0.00	0.00	0.00	14.68	88.41%
21133	Library	LI	64	126.68	0.00	0.00	0.00	126.68	2.31	0.00	0.00	0.00	2.31	98.18%
21981	Library	LI	600	127.64	0.00	0.00	0.00	127.64	65.04	0.00	0.00	0.00	65.04	49.04%
22668	Library	LI	600	127.42	0.00	0.00	0.00	127.42	78.80	0.00	0.00	0.00	78.80	38.16%

Building Summary Totals				Lights On KWHR					Occupied KWHR				
Area Type		Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
Restroom	R	2	576	42	0	0	0	42	13	0	0	0	13
Hallway	H	3	813	120	0	0	0	120	59	0	0	0	59
Classroom	CR	1	1152	9	0	0	0	9	4	0	0	0	4
Janitor Closet	J	1	64	4	0	0	0	4	2	0	0	0	2
Copy Rm	C	1	34	2	0	0	0	2	1	0	0	0	1
Library	LI	7	2989	379	0	0	0	379	143	0	0	0	143
Office	O	3	1350	49	0	0	0	49	39	0	0	0	39
Lobby	LB	1	300	50	0	0	0	50	13	0	0	0	13
Building Totals			7278	656			0	656	274			0	274