


Area Type Averages

Building type:High School. Building size:100K to less than 250K. Shifts:2

Area Type Averages				Normalized Weekly Lights On					Normalized Weekly Occupied					
Area Type		Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav
Restroom	R	1	100	69.91	0.00	0.00	0.00	69.91	37.32	0.00	0.00	0.00	37.32	46.62%
Hallway	H	2	100	43.08	0.00	0.00	0.00	43.08	31.59	0.00	0.00	0.00	31.59	26.67%
Classroom	CR	7	100	39.46	0.00	0.00	0.00	39.46	20.54	0.00	0.00	0.00	20.54	47.95%
Gym	G	1	100	55.59	0.00	0.00	0.00	55.59	28.20	0.00	0.00	0.00	28.20	49.27%
Conference	CN	1	100	50.18	0.00	0.00	0.00	50.18	29.32	0.00	0.00	0.00	29.32	41.57%
Building Average			1200	44.84			0.00	44.84	25.15			0.00	25.15	43.91%

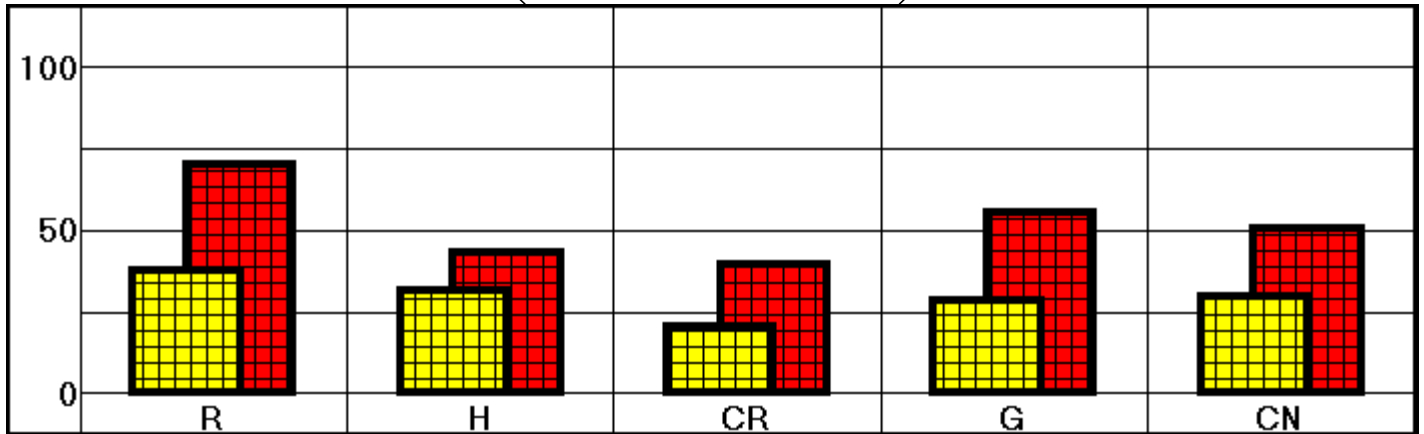

Hours per Week for each Area Type

Data Logger Detail Building type:High School. Building size:100K to less than 250K. Shifts:2

All Loggers Listed			Hours Installed					Lights On					Occupied						
Logger	Area Type	Ty	Total	Peak	Off	Shldr 1	Shldr 2	Installed	Removed	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
20151	Hallway	H	881.60	881.60	0.00	0.00	0.00	10/04/05 4:25 PM	11/10/05 10:00	207.58	0.00	0.00	0.00	207.58	116.60	0.00	0.00	0.00	116.60
20458	Classroom	CR	895.42	895.42	0.00	0.00	0.00	10/04/05 4:36 PM	11/11/05 12:00	190.47	0.00	0.00	0.00	190.47	96.58	0.00	0.00	0.00	96.58
24607	Classroom	CR	885.33	885.33	0.00	0.00	0.00	10/04/05 12:19	11/10/05 9:38 AM	158.23	0.00	0.00	0.00	158.23	139.73	0.00	0.00	0.00	139.73
20148	Classroom	CR	544.23	544.23	0.00	0.00	0.00	10/04/05 3:15 PM	10/27/05 7:28 AM	163.23	0.00	0.00	0.00	163.23	123.93	0.00	0.00	0.00	123.93
22969	Classroom	CR	881.12	881.12	0.00	0.00	0.00	10/04/05 4:19 PM	11/10/05 9:25 AM	172.57	0.00	0.00	0.00	172.57	3.83	0.00	0.00	0.00	3.83
20319	Classroom	CR	882.75	882.75	0.00	0.00	0.00	10/04/05 3:19 PM	11/10/05 10:03	252.77	0.00	0.00	0.00	252.77	103.07	0.00	0.00	0.00	103.07
22987	Classroom	CR	881.32	881.32	0.00	0.00	0.00	10/04/05 4:16 PM	11/10/05 9:34 AM	170.67	0.00	0.00	0.00	170.67	116.30	0.00	0.00	0.00	116.30
20456	Classroom	CR	906.15	906.15	0.00	0.00	0.00	10/04/05 4:31 PM	11/11/05 10:39	250.93	0.00	0.00	0.00	250.93	99.00	0.00	0.00	0.00	99.00
20214	Conference	CN	887.82	887.82	0.00	0.00	0.00	10/04/05 10:20	11/10/05 10:08	265.18	0.00	0.00	0.00	265.18	154.93	0.00	0.00	0.00	154.93
20464	Gym	G	898.02	898.02	0.00	0.00	0.00	10/04/05 12:00	11/10/05 10:00	297.13	0.00	0.00	0.00	297.13	150.73	0.00	0.00	0.00	150.73
20450	Restroom	R	887.38	887.38	0.00	0.00	0.00	10/04/05 10:36	11/10/05 9:58 AM	369.27	0.00	0.00	0.00	369.27	197.10	0.00	0.00	0.00	197.10
24704	Hallway	H	881.50	881.50	0.00	0.00	0.00	10/04/05 3:55 PM	11/10/05 9:24 AM	244.47	0.00	0.00	0.00	244.47	214.93	0.00	0.00	0.00	214.93

Normalized Data Logger Detail Building type:High School. Building size:100K to less than 250K. Shifts:2

All Loggers Listed			Load	Normalized Weekly Hours of Use					Normalized Weekly Hours of Occupancy					
Logger	Area Type	Ty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav
20151	Hallway	H	100	39.56	0.00	0.00	0.00	39.56	22.22	0.00	0.00	0.00	22.22	43.83%
20458	Classroom	CR	100	35.74	0.00	0.00	0.00	35.74	18.12	0.00	0.00	0.00	18.12	49.30%
24607	Classroom	CR	100	30.03	0.00	0.00	0.00	30.03	26.52	0.00	0.00	0.00	26.52	11.69%
20148	Classroom	CR	100	50.39	0.00	0.00	0.00	50.39	38.26	0.00	0.00	0.00	38.26	24.07%
22969	Classroom	CR	100	32.90	0.00	0.00	0.00	32.90	0.73	0.00	0.00	0.00	0.73	97.78%
20319	Classroom	CR	100	48.11	0.00	0.00	0.00	48.11	19.62	0.00	0.00	0.00	19.62	59.22%
22987	Classroom	CR	100	32.53	0.00	0.00	0.00	32.53	22.17	0.00	0.00	0.00	22.17	31.85%
20456	Classroom	CR	100	46.52	0.00	0.00	0.00	46.52	18.35	0.00	0.00	0.00	18.35	60.55%
20214	Conference	CN	100	50.18	0.00	0.00	0.00	50.18	29.32	0.00	0.00	0.00	29.32	41.57%
20464	Gym	G	100	55.59	0.00	0.00	0.00	55.59	28.20	0.00	0.00	0.00	28.20	49.27%
20450	Restroom	R	100	69.91	0.00	0.00	0.00	69.91	37.32	0.00	0.00	0.00	37.32	46.62%
24704	Hallway	H	100	46.59	0.00	0.00	0.00	46.59	40.96	0.00	0.00	0.00	40.96	12.08%

Building Summary Totals Building type:High School. Building size:100K to less than 250K. Shifts:2

Building Summary Totals				Lights On KWHR					Occupied KWHR				
Area Type		Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
Restroom	R	1	100	7	0	0	0	7	4	0	0	0	4
Hallway	H	2	200	9	0	0	0	9	6	0	0	0	6
Classroom	CR	7	700	28	0	0	0	28	14	0	0	0	14
Gym	G	1	100	6	0	0	0	6	3	0	0	0	3
Conference	CN	1	100	5	0	0	0	5	3	0	0	0	3
Building Totals			1200	54			0	54	30			0	30