


Area Type Averages

Building type:Hospital. Building size:100K to less than 250K. Shifts:3

| Area Type Averages | | | | Normalized Weekly Lights On | | | | | Normalized Weekly Occupied | | | | | |
|--------------------|-----|-------|------|-----------------------------|------|---------|---------|--------|----------------------------|------|---------|---------|--------|--------|
| Area Type | Qty | Watts | | Peak | Off | Shldr 1 | Shldr 2 | Total | Peak | Off | Shldr 1 | Shldr 2 | Total | % sav |
| Restroom | R | 4 | 200 | 135.95 | 0.00 | 0.00 | 0.00 | 135.95 | 39.96 | 0.00 | 0.00 | 0.00 | 39.96 | 70.61% |
| Hallway | H | 12 | 200 | 124.47 | 0.00 | 0.00 | 0.00 | 124.47 | 77.61 | 0.00 | 0.00 | 0.00 | 77.61 | 37.65% |
| Classroom | CR | 1 | 200 | 20.32 | 0.00 | 0.00 | 0.00 | 20.32 | 16.50 | 0.00 | 0.00 | 0.00 | 16.50 | 18.80% |
| Copy Rm | C | 1 | 200 | 36.02 | 0.00 | 0.00 | 0.00 | 36.02 | 35.40 | 0.00 | 0.00 | 0.00 | 35.40 | 1.72% |
| Cafeteria | CF | 2 | 200 | 128.55 | 0.00 | 0.00 | 0.00 | 128.55 | 100.75 | 0.00 | 0.00 | 0.00 | 100.75 | 21.63% |
| Patient Room | P | 4 | 200 | 24.49 | 0.00 | 0.00 | 0.00 | 24.49 | 18.49 | 0.00 | 0.00 | 0.00 | 18.49 | 24.50% |
| Waiting Room | WF | 2 | 200 | 131.89 | 0.00 | 0.00 | 0.00 | 131.89 | 119.87 | 0.00 | 0.00 | 0.00 | 119.87 | 9.11% |
| Office | O | 2 | 200 | 34.69 | 0.00 | 0.00 | 0.00 | 34.69 | 26.09 | 0.00 | 0.00 | 0.00 | 26.09 | 24.79% |
| Stairwell | ST | 3 | 200 | 61.47 | 0.00 | 0.00 | 0.00 | 61.47 | 11.50 | 0.00 | 0.00 | 0.00 | 11.50 | 81.29% |
| Whse/Storage | WS | 2 | 200 | 64.52 | 0.00 | 0.00 | 0.00 | 64.52 | 54.49 | 0.00 | 0.00 | 0.00 | 54.49 | 15.55% |
| Operating Rooms | OR | 1 | 200 | 101.02 | 0.00 | 0.00 | 0.00 | 101.02 | 39.07 | 0.00 | 0.00 | 0.00 | 39.07 | 61.32% |
| General Office | GO | 1 | 200 | 133.75 | 0.00 | 0.00 | 0.00 | 133.75 | 128.47 | 0.00 | 0.00 | 0.00 | 128.47 | 3.95% |
| MultiPurpose Rm | MP | 1 | 200 | 168.00 | 0.00 | 0.00 | 0.00 | 168.00 | 78.12 | 0.00 | 0.00 | 0.00 | 78.12 | 53.50% |
| Building Average | | | 7200 | 97.17 | | | 0.00 | 97.17 | 58.32 | | | 0.00 | 58.32 | 39.98% |

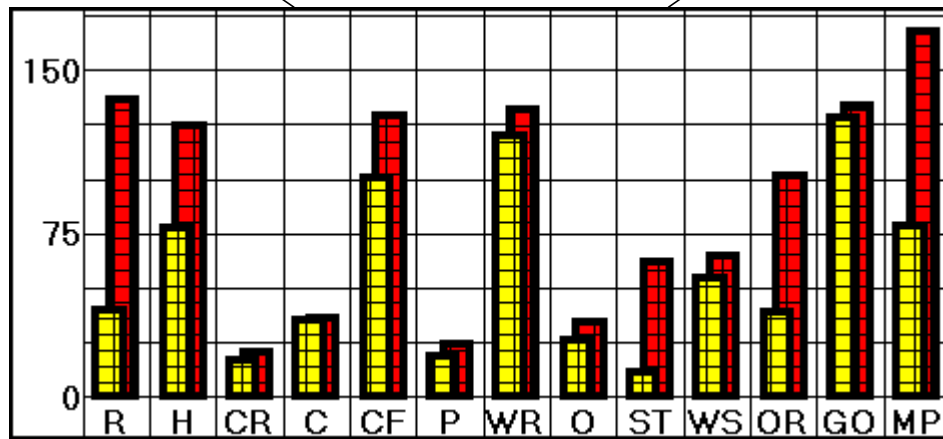

Hours per Week for each Area Type

Data Logger Detail Building type:Hospital. Building size:100K to less than 250K. Shifts:3 Page 1 of 1

| All Loggers Listed | | | Hours Installed | | | | | Lights On | | | | | Occupied | | | | | | |
|--------------------|-----------------|----|-----------------|--------|------|---------|---------|------------------|------------------|--------|------|---------|----------|--------|--------|------|---------|---------|--------|
| Logger | Area Type | Ty | Total | Peak | Off | Shldr 1 | Shldr 2 | Installed | Removed | Peak | Off | Shldr 1 | Shldr 2 | Total | Peak | Off | Shldr 1 | Shldr 2 | Total |
| 21901 | Cafeteria | CF | 485.07 | 485.07 | 0.00 | 0.00 | 0.00 | 11/09/05 3:57 PM | 11/29/05 9:00 PM | 352.87 | 0.00 | 0.00 | 0.00 | 352.87 | 263.90 | 0.00 | 0.00 | 0.00 | 263.90 |
| 21307 | Restroom | R | 484.98 | 484.98 | 0.00 | 0.00 | 0.00 | 11/09/05 4:02 PM | 11/29/05 9:00 PM | 412.35 | 0.00 | 0.00 | 0.00 | 412.35 | 130.87 | 0.00 | 0.00 | 0.00 | 130.87 |
| 20548 | Waiting Room | WF | 485.18 | 485.18 | 0.00 | 0.00 | 0.00 | 11/09/05 3:50 PM | 11/29/05 9:00 PM | 485.18 | 0.00 | 0.00 | 0.00 | 485.18 | 422.05 | 0.00 | 0.00 | 0.00 | 422.05 |
| 21862 | Hallway | H | 485.52 | 485.52 | 0.00 | 0.00 | 0.00 | 11/09/05 3:30 PM | 11/29/05 9:00 PM | 290.58 | 0.00 | 0.00 | 0.00 | 290.58 | 258.00 | 0.00 | 0.00 | 0.00 | 258.00 |
| 22760 | Hallway | H | 485.23 | 485.23 | 0.00 | 0.00 | 0.00 | 11/09/05 3:47 PM | 11/29/05 9:00 PM | 485.23 | 0.00 | 0.00 | 0.00 | 485.23 | 217.20 | 0.00 | 0.00 | 0.00 | 217.20 |
| 20749 | Restroom | R | 485.45 | 485.45 | 0.00 | 0.00 | 0.00 | 11/09/05 3:34 PM | 11/29/05 9:00 PM | 485.45 | 0.00 | 0.00 | 0.00 | 485.45 | 121.87 | 0.00 | 0.00 | 0.00 | 121.87 |
| 20682 | Stock Room | ST | 485.25 | 485.25 | 0.00 | 0.00 | 0.00 | 11/09/05 3:46 PM | 11/29/05 9:00 PM | 485.08 | 0.00 | 0.00 | 0.00 | 485.08 | 76.37 | 0.00 | 0.00 | 0.00 | 76.37 |
| 23620 | Hallway | H | 485.67 | 485.67 | 0.00 | 0.00 | 0.00 | 11/09/05 3:21 PM | 11/29/05 9:00 PM | 485.63 | 0.00 | 0.00 | 0.00 | 485.63 | 361.43 | 0.00 | 0.00 | 0.00 | 361.43 |
| 20810 | Hallway | H | 485.98 | 485.98 | 0.00 | 0.00 | 0.00 | 11/09/05 3:02 PM | 11/29/05 9:00 PM | 334.02 | 0.00 | 0.00 | 0.00 | 334.02 | 194.93 | 0.00 | 0.00 | 0.00 | 194.93 |
| 23734 | General Office | GO | 486.08 | 486.08 | 0.00 | 0.00 | 0.00 | 11/09/05 2:56 PM | 11/29/05 9:00 PM | 386.98 | 0.00 | 0.00 | 0.00 | 386.98 | 371.72 | 0.00 | 0.00 | 0.00 | 371.72 |
| 20902 | Hallway | H | 486.40 | 486.40 | 0.00 | 0.00 | 0.00 | 11/09/05 2:37 PM | 11/29/05 9:00 PM | 118.33 | 0.00 | 0.00 | 0.00 | 118.33 | 100.87 | 0.00 | 0.00 | 0.00 | 100.87 |
| 24066 | Workshop | WS | 486.30 | 486.30 | 0.00 | 0.00 | 0.00 | 11/09/05 2:43 PM | 11/29/05 9:00 PM | 121.10 | 0.00 | 0.00 | 0.00 | 121.10 | 112.33 | 0.00 | 0.00 | 0.00 | 112.33 |
| 22857 | Hallway | H | 486.70 | 486.70 | 0.00 | 0.00 | 0.00 | 11/09/05 2:19 PM | 11/29/05 9:00 PM | 486.70 | 0.00 | 0.00 | 0.00 | 486.70 | 181.40 | 0.00 | 0.00 | 0.00 | 181.40 |
| 24061 | Office | O | 486.82 | 486.82 | 0.00 | 0.00 | 0.00 | 11/09/05 2:12 PM | 11/29/05 9:00 PM | 6.47 | 0.00 | 0.00 | 0.00 | 6.47 | 5.47 | 0.00 | 0.00 | 0.00 | 5.47 |
| 23536 | Hallway | H | 486.88 | 486.88 | 0.00 | 0.00 | 0.00 | 11/09/05 2:08 PM | 11/29/05 9:00 PM | 13.50 | 0.00 | 0.00 | 0.00 | 13.50 | 12.67 | 0.00 | 0.00 | 0.00 | 12.67 |
| 24053 | Hallway | H | 486.80 | 486.80 | 0.00 | 0.00 | 0.00 | 11/09/05 2:13 PM | 11/29/05 9:00 PM | 333.28 | 0.00 | 0.00 | 0.00 | 333.28 | 311.97 | 0.00 | 0.00 | 0.00 | 311.97 |
| 23866 | Office | O | 485.63 | 485.63 | 0.00 | 0.00 | 0.00 | 11/09/05 3:23 PM | 11/29/05 9:00 PM | 194.07 | 0.00 | 0.00 | 0.00 | 194.07 | 145.37 | 0.00 | 0.00 | 0.00 | 145.37 |
| 21341 | Classroom | CR | 485.93 | 485.93 | 0.00 | 0.00 | 0.00 | 11/09/05 3:05 PM | 11/29/05 9:00 PM | 58.78 | 0.00 | 0.00 | 0.00 | 58.78 | 47.73 | 0.00 | 0.00 | 0.00 | 47.73 |
| 21992 | Waiting Room | WF | 485.27 | 485.27 | 0.00 | 0.00 | 0.00 | 11/09/05 3:45 PM | 11/29/05 9:00 PM | 276.67 | 0.00 | 0.00 | 0.00 | 276.67 | 270.33 | 0.00 | 0.00 | 0.00 | 270.33 |
| 24360 | Copy Rm | C | 485.65 | 485.65 | 0.00 | 0.00 | 0.00 | 11/09/05 3:22 PM | 11/29/05 9:00 PM | 104.13 | 0.00 | 0.00 | 0.00 | 104.13 | 102.33 | 0.00 | 0.00 | 0.00 | 102.33 |
| 22290 | Hallway | H | 485.10 | 485.10 | 0.00 | 0.00 | 0.00 | 11/09/05 3:55 PM | 11/29/05 9:00 PM | 485.10 | 0.00 | 0.00 | 0.00 | 485.10 | 449.27 | 0.00 | 0.00 | 0.00 | 449.27 |
| 24035 | Hallway | H | 486.60 | 486.60 | 0.00 | 0.00 | 0.00 | 11/09/05 2:25 PM | 11/29/05 9:00 PM | 316.03 | 0.00 | 0.00 | 0.00 | 316.03 | 286.53 | 0.00 | 0.00 | 0.00 | 286.53 |
| 24060 | Hallway | H | 484.87 | 484.87 | 0.00 | 0.00 | 0.00 | 11/09/05 4:09 PM | 11/29/05 9:00 PM | 484.87 | 0.00 | 0.00 | 0.00 | 484.87 | 317.53 | 0.00 | 0.00 | 0.00 | 317.53 |
| 21292 | Hallway | H | 485.03 | 485.03 | 0.00 | 0.00 | 0.00 | 11/09/05 3:59 PM | 11/29/05 9:00 PM | 485.03 | 0.00 | 0.00 | 0.00 | 485.03 | 1.03 | 0.00 | 0.00 | 0.00 | 1.03 |
| 20882 | Cafeteria | CF | 485.70 | 485.70 | 0.00 | 0.00 | 0.00 | 11/09/05 3:19 PM | 11/29/05 9:00 PM | 389.95 | 0.00 | 0.00 | 0.00 | 389.95 | 318.30 | 0.00 | 0.00 | 0.00 | 318.30 |
| 22613 | Restroom | R | 484.95 | 484.95 | 0.00 | 0.00 | 0.00 | 11/09/05 4:04 PM | 11/29/05 9:00 PM | 484.95 | 0.00 | 0.00 | 0.00 | 484.95 | 132.70 | 0.00 | 0.00 | 0.00 | 132.70 |
| 20844 | Restroom | R | 485.95 | 485.95 | 0.00 | 0.00 | 0.00 | 11/09/05 3:04 PM | 11/29/05 9:00 PM | 187.90 | 0.00 | 0.00 | 0.00 | 187.90 | 76.23 | 0.00 | 0.00 | 0.00 | 76.23 |
| 23910 | MultiPurpose Rm | MP | 484.92 | 484.92 | 0.00 | 0.00 | 0.00 | 11/09/05 4:06 PM | 11/29/05 9:00 PM | 484.92 | 0.00 | 0.00 | 0.00 | 484.92 | 225.50 | 0.00 | 0.00 | 0.00 | 225.50 |
| 23758 | Patient Room | P | 486.33 | 486.33 | 0.00 | 0.00 | 0.00 | 11/09/05 2:41 PM | 11/29/05 9:00 PM | 144.55 | 0.00 | 0.00 | 0.00 | 144.55 | 124.98 | 0.00 | 0.00 | 0.00 | 124.98 |
| 23864 | Patient Room | P | 486.23 | 486.23 | 0.00 | 0.00 | 0.00 | 11/09/05 2:47 PM | 11/29/05 9:00 PM | 12.27 | 0.00 | 0.00 | 0.00 | 12.27 | 9.93 | 0.00 | 0.00 | 0.00 | 9.93 |
| 23238 | Patient Room | P | 486.75 | 486.75 | 0.00 | 0.00 | 0.00 | 11/09/05 2:16 PM | 11/29/05 9:00 PM | 60.30 | 0.00 | 0.00 | 0.00 | 60.30 | 45.93 | 0.00 | 0.00 | 0.00 | 45.93 |
| 23697 | Patient Room | P | 485.15 | 485.15 | 0.00 | 0.00 | 0.00 | 11/09/05 3:52 PM | 11/29/05 9:00 PM | 66.37 | 0.00 | 0.00 | 0.00 | 66.37 | 33.27 | 0.00 | 0.00 | 0.00 | 33.27 |
| 20592 | Operating Rooms | OR | 485.50 | 485.50 | 0.00 | 0.00 | 0.00 | 11/09/05 3:31 PM | 11/29/05 9:00 PM | 291.93 | 0.00 | 0.00 | 0.00 | 291.93 | 112.90 | 0.00 | 0.00 | 0.00 | 112.90 |
| 20825 | Stock Room | ST | 485.13 | 485.13 | 0.00 | 0.00 | 0.00 | 11/09/05 3:53 PM | 11/29/05 9:00 PM | 23.37 | 0.00 | 0.00 | 0.00 | 23.37 | 14.53 | 0.00 | 0.00 | 0.00 | 14.53 |
| 23581 | Stock Room | ST | 486.67 | 486.67 | 0.00 | 0.00 | 0.00 | 11/09/05 2:21 PM | 11/29/05 9:00 PM | 24.30 | 0.00 | 0.00 | 0.00 | 24.30 | 8.77 | 0.00 | 0.00 | 0.00 | 8.77 |
| 22548 | Workshop | WS | 486.03 | 486.03 | 0.00 | 0.00 | 0.00 | 11/09/05 2:59 PM | 11/29/05 9:00 PM | 252.23 | 0.00 | 0.00 | 0.00 | 252.23 | 203.00 | 0.00 | 0.00 | 0.00 | 203.00 |

| All Loggers Listed | | | Load | Normalized Weekly Hours of Use | | | | | Normalized Weekly Hours of Occupancy | | | | | |
|--------------------|----------------|----|-------|--------------------------------|------|---------|---------|--------|--------------------------------------|------|---------|---------|--------|--------|
| Logger | Area Type | Ty | Watts | Peak | Off | Shldr 1 | Shldr 2 | Total | Peak | Off | Shldr 1 | Shldr 2 | Total | % sav |
| 21901 | Cafeteria | CF | 200 | 122.21 | 0.00 | 0.00 | 0.00 | 122.21 | 91.40 | 0.00 | 0.00 | 0.00 | 91.40 | 25.21% |
| 21307 | Restroom | R | 200 | 142.84 | 0.00 | 0.00 | 0.00 | 142.84 | 45.33 | 0.00 | 0.00 | 0.00 | 45.33 | 68.27% |
| 20548 | Waiting Room | WF | 200 | 168.00 | 0.00 | 0.00 | 0.00 | 168.00 | 146.14 | 0.00 | 0.00 | 0.00 | 146.14 | 13.01% |
| 21862 | Hallway | H | 200 | 100.55 | 0.00 | 0.00 | 0.00 | 100.55 | 89.27 | 0.00 | 0.00 | 0.00 | 89.27 | 11.22% |
| 22760 | Hallway | H | 200 | 168.00 | 0.00 | 0.00 | 0.00 | 168.00 | 75.20 | 0.00 | 0.00 | 0.00 | 75.20 | 55.24% |
| 20749 | Restroom | R | 200 | 168.00 | 0.00 | 0.00 | 0.00 | 168.00 | 42.17 | 0.00 | 0.00 | 0.00 | 42.17 | 74.90% |
| 20682 | Stock Room | ST | 200 | 167.94 | 0.00 | 0.00 | 0.00 | 167.94 | 26.44 | 0.00 | 0.00 | 0.00 | 26.44 | 84.26% |
| 23620 | Hallway | H | 200 | 167.99 | 0.00 | 0.00 | 0.00 | 167.99 | 125.03 | 0.00 | 0.00 | 0.00 | 125.03 | 25.57% |
| 20810 | Hallway | H | 200 | 115.47 | 0.00 | 0.00 | 0.00 | 115.47 | 67.39 | 0.00 | 0.00 | 0.00 | 67.39 | 41.64% |
| 23734 | General Office | GO | 200 | 133.75 | 0.00 | 0.00 | 0.00 | 133.75 | 128.47 | 0.00 | 0.00 | 0.00 | 128.47 | 3.95% |
| 20902 | Hallway | H | 200 | 40.87 | 0.00 | 0.00 | 0.00 | 40.87 | 34.84 | 0.00 | 0.00 | 0.00 | 34.84 | 14.75% |
| 24066 | Workshop | WS | 200 | 41.84 | 0.00 | 0.00 | 0.00 | 41.84 | 38.81 | 0.00 | 0.00 | 0.00 | 38.81 | 7.24% |
| 22857 | Hallway | H | 200 | 168.00 | 0.00 | 0.00 | 0.00 | 168.00 | 62.62 | 0.00 | 0.00 | 0.00 | 62.62 | 62.73% |
| 24061 | Office | O | 200 | 2.23 | 0.00 | 0.00 | 0.00 | 2.23 | 1.89 | 0.00 | 0.00 | 0.00 | 1.89 | 15.25% |
| 23536 | Hallway | H | 200 | 4.66 | 0.00 | 0.00 | 0.00 | 4.66 | 4.37 | 0.00 | 0.00 | 0.00 | 4.37 | 6.22% |
| 24053 | Hallway | H | 200 | 115.02 | 0.00 | 0.00 | 0.00 | 115.02 | 107.66 | 0.00 | 0.00 | 0.00 | 107.66 | 6.40% |
| 23866 | Office | O | 200 | 67.14 | 0.00 | 0.00 | 0.00 | 67.14 | 50.29 | 0.00 | 0.00 | 0.00 | 50.29 | 25.10% |
| 21341 | Classroom | CR | 200 | 20.32 | 0.00 | 0.00 | 0.00 | 20.32 | 16.50 | 0.00 | 0.00 | 0.00 | 16.50 | 18.80% |
| 21992 | Waiting Room | WF | 200 | 95.78 | 0.00 | 0.00 | 0.00 | 95.78 | 93.59 | 0.00 | 0.00 | 0.00 | 93.59 | 2.29% |
| 24360 | Copy Rm | C | 200 | 36.02 | 0.00 | 0.00 | 0.00 | 36.02 | 35.40 | 0.00 | 0.00 | 0.00 | 35.40 | 1.72% |
| 22290 | Hallway | H | 200 | 168.00 | 0.00 | 0.00 | 0.00 | 168.00 | 155.59 | 0.00 | 0.00 | 0.00 | 155.59 | 7.39% |
| 24035 | Hallway | H | 200 | 109.11 | 0.00 | 0.00 | 0.00 | 109.11 | 98.93 | 0.00 | 0.00 | 0.00 | 98.93 | 9.33% |
| 24060 | Hallway | H | 200 | 168.00 | 0.00 | 0.00 | 0.00 | 168.00 | 110.02 | 0.00 | 0.00 | 0.00 | 110.02 | 34.51% |
| 21292 | Hallway | H | 200 | 168.00 | 0.00 | 0.00 | 0.00 | 168.00 | 0.36 | 0.00 | 0.00 | 0.00 | 0.36 | 99.79% |
| 20882 | Cafeteria | CF | 200 | 134.88 | 0.00 | 0.00 | 0.00 | 134.88 | 110.10 | 0.00 | 0.00 | 0.00 | 110.10 | 18.37% |
| 22613 | Restroom | R | 200 | 168.00 | 0.00 | 0.00 | 0.00 | 168.00 | 45.97 | 0.00 | 0.00 | 0.00 | 45.97 | 72.64% |
| 20844 | Restroom | R | 200 | 64.96 | 0.00 | 0.00 | 0.00 | 64.96 | 26.35 | 0.00 | 0.00 | 0.00 | 26.35 | 59.44% |
| 23910 | MultiPurpose | MP | 200 | 168.00 | 0.00 | 0.00 | 0.00 | 168.00 | 78.12 | 0.00 | 0.00 | 0.00 | 78.12 | 53.50% |
| 23758 | Patient Room | P | 200 | 49.93 | 0.00 | 0.00 | 0.00 | 49.93 | 43.17 | 0.00 | 0.00 | 0.00 | 43.17 | 13.54% |
| 23864 | Patient Room | P | 200 | 4.24 | 0.00 | 0.00 | 0.00 | 4.24 | 3.43 | 0.00 | 0.00 | 0.00 | 3.43 | 19.10% |
| 23238 | Patient Room | P | 200 | 20.81 | 0.00 | 0.00 | 0.00 | 20.81 | 15.85 | 0.00 | 0.00 | 0.00 | 15.85 | 23.83% |
| 23697 | Patient Room | P | 200 | 22.98 | 0.00 | 0.00 | 0.00 | 22.98 | 11.52 | 0.00 | 0.00 | 0.00 | 11.52 | 49.87% |
| 20592 | Operating | OR | 200 | 101.02 | 0.00 | 0.00 | 0.00 | 101.02 | 39.07 | 0.00 | 0.00 | 0.00 | 39.07 | 61.32% |
| 20825 | Stock Room | ST | 200 | 8.09 | 0.00 | 0.00 | 0.00 | 8.09 | 5.03 | 0.00 | 0.00 | 0.00 | 5.03 | 37.82% |
| 23581 | Stock Room | ST | 200 | 8.39 | 0.00 | 0.00 | 0.00 | 8.39 | 3.03 | 0.00 | 0.00 | 0.00 | 3.03 | 63.89% |
| 22548 | Workshop | WS | 200 | 87.19 | 0.00 | 0.00 | 0.00 | 87.19 | 70.17 | 0.00 | 0.00 | 0.00 | 70.17 | 19.52% |

| Building Summary Totals | | | | Lights On KWHR | | | | | Occupied KWHR | | | | |
|-------------------------|----|-----|-------|----------------|-----|---------|---------|-------|---------------|-----|---------|---------|-------|
| Area Type | | Qty | Watts | Peak | Off | Shldr 1 | Shldr 2 | Total | Peak | Off | Shldr 1 | Shldr 2 | Total |
| Restroom | R | 4 | 800 | 109 | 0 | 0 | 0 | 109 | 32 | 0 | 0 | 0 | 32 |
| Hallway | H | 12 | 2400 | 299 | 0 | 0 | 0 | 299 | 186 | 0 | 0 | 0 | 186 |
| Classroom | CR | 1 | 200 | 4 | 0 | 0 | 0 | 4 | 3 | 0 | 0 | 0 | 3 |
| Copy Rm | C | 1 | 200 | 7 | 0 | 0 | 0 | 7 | 7 | 0 | 0 | 0 | 7 |
| Cafeteria | CF | 2 | 400 | 51 | 0 | 0 | 0 | 51 | 40 | 0 | 0 | 0 | 40 |
| Patient Room | P | 4 | 800 | 20 | 0 | 0 | 0 | 20 | 15 | 0 | 0 | 0 | 15 |
| Waiting Room | WF | 2 | 400 | 53 | 0 | 0 | 0 | 53 | 48 | 0 | 0 | 0 | 48 |
| Office | O | 2 | 400 | 14 | 0 | 0 | 0 | 14 | 10 | 0 | 0 | 0 | 10 |
| Stairwell | ST | 3 | 600 | 37 | 0 | 0 | 0 | 37 | 7 | 0 | 0 | 0 | 7 |
| Whse/Storage | WS | 2 | 400 | 26 | 0 | 0 | 0 | 26 | 22 | 0 | 0 | 0 | 22 |
| Operating Rooms | OR | 1 | 200 | 20 | 0 | 0 | 0 | 20 | 8 | 0 | 0 | 0 | 8 |
| General Office | GO | 1 | 200 | 27 | 0 | 0 | 0 | 27 | 26 | 0 | 0 | 0 | 26 |
| MultiPurpose Rm | MP | 1 | 200 | 34 | 0 | 0 | 0 | 34 | 16 | 0 | 0 | 0 | 16 |
| Building Totals | | | 7200 | 700 | 0 | | | 700 | 420 | 0 | | | 420 |