


Area Type Averages

Building type:Industrial Manufacturing. Building size:250K to less than 500K. Shifts:3

Area Type Averages				Normalized Weekly Lights On					Normalized Weekly Occupied					
Area Type	Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav	
Restroom	R	3	400	107.24	0.00	0.00	107.24	56.70	0.00	0.00	0.00	56.70	47.13%	
Hallway	H	1	450	167.58	0.00	0.00	167.58	62.49	0.00	0.00	0.00	62.49	62.71%	
Kitchen	K	1	400	38.13	0.00	0.00	38.13	30.65	0.00	0.00	0.00	30.65	19.62%	
Locker Room	LR	2	200	144.44	0.00	0.00	144.44	90.65	0.00	0.00	0.00	90.65	37.24%	
Warehouse	W	4	2013	106.63	0.00	0.00	106.63	33.96	0.00	0.00	0.00	33.96	68.15%	
Cafeteria	CF	1	1350	150.10	0.00	0.00	150.10	115.83	0.00	0.00	0.00	115.83	22.83%	
Open Office	OO	3	1183	58.32	0.00	0.00	58.32	53.84	0.00	0.00	0.00	53.84	7.68%	
Conference	CN	3	600	37.52	0.00	0.00	37.52	30.45	0.00	0.00	0.00	30.45	18.84%	
Building Average			17201	93.77			93.77	47.69			0.00	47.69	49.14%	

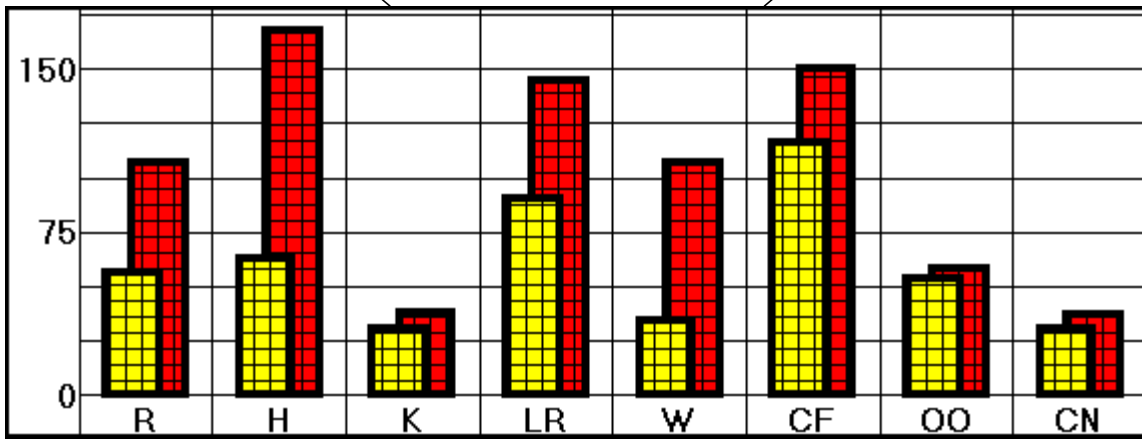

Hours per Week for each Area Type

Data Logger Detail Building type:Industrial Manufacturing. Building size:250K to less than 500K. Shifts:3 Page 1 of 1

All Loggers Listed			Hours Installed							Lights On					Occupied				
Logger	Area Type	Ty	Total	Peak	Off	Shldr 1	Shldr 2	Installed	Removed	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
12	Open Office	OO	324.53	324.53	0.00	0.00	0.00	10/21/05 11:29	11/04/05 12:00	90.22	0.00	0.00	0.00	90.22	88.95	0.00	0.00	0.00	88.95
11	Open Office	OO	324.60	324.60	0.00	0.00	0.00	10/21/05 11:25	11/04/05 12:00	105.72	0.00	0.00	0.00	105.72	103.08	0.00	0.00	0.00	103.08
24154	Kitchen	K	324.68	324.68	0.00	0.00	0.00	10/21/05 11:20	11/04/05 12:00	73.70	0.00	0.00	0.00	73.70	59.23	0.00	0.00	0.00	59.23
5	Hallway	H	325.63	325.63	0.00	0.00	0.00	10/21/05 10:23	11/04/05 12:00	324.82	0.00	0.00	0.00	324.82	121.12	0.00	0.00	0.00	121.12
6	Conference	CN	325.52	325.52	0.00	0.00	0.00	10/21/05 10:30	11/04/05 12:00	42.03	0.00	0.00	0.00	42.03	34.80	0.00	0.00	0.00	34.80
3	Conference	CN	325.82	325.82	0.00	0.00	0.00	10/21/05 10:12	11/04/05 12:00	17.82	0.00	0.00	0.00	17.82	16.43	0.00	0.00	0.00	16.43
4	Conference	CN	325.78	325.78	0.00	0.00	0.00	10/21/05 10:14	11/04/05 12:00	158.42	0.00	0.00	0.00	158.42	125.92	0.00	0.00	0.00	125.92
23194	Cafeteria	CF	327.23	327.23	0.00	0.00	0.00	10/21/05 8:47 AM	11/04/05 12:00	292.37	0.00	0.00	0.00	292.37	225.62	0.00	0.00	0.00	225.62
13	Warehouse	W	323.15	323.15	0.00	0.00	0.00	10/21/05 12:52	11/04/05 12:00	51.93	0.00	0.00	0.00	51.93	4.23	0.00	0.00	0.00	4.23
10	Restroom	R	324.85	324.85	0.00	0.00	0.00	10/21/05 11:10	11/04/05 12:00	132.80	0.00	0.00	0.00	132.80	75.48	0.00	0.00	0.00	75.48
24243	Restroom	R	327.12	327.12	0.00	0.00	0.00	10/21/05 8:54 AM	11/04/05 12:00	327.12	0.00	0.00	0.00	327.12	203.68	0.00	0.00	0.00	203.68
16	Warehouse	W	321.37	321.37	0.00	0.00	0.00	10/21/05 2:39 PM	11/04/05 12:00	298.27	0.00	0.00	0.00	298.27	184.42	0.00	0.00	0.00	184.42
14	Warehouse	W	321.68	321.68	0.00	0.00	0.00	10/21/05 2:20 PM	11/04/05 12:00	272.27	0.00	0.00	0.00	272.27	63.20	0.00	0.00	0.00	63.20
15	Warehouse	W	321.47	321.47	0.00	0.00	0.00	10/21/05 2:33 PM	11/04/05 12:00	194.05	0.00	0.00	0.00	194.05	8.03	0.00	0.00	0.00	8.03
8	Open Office	OO	325.12	325.12	0.00	0.00	0.00	10/21/05 10:54	11/04/05 12:00	142.35	0.00	0.00	0.00	142.35	120.20	0.00	0.00	0.00	120.20
7	Locker Room	LR	325.40	325.40	0.00	0.00	0.00	10/21/05 10:37	11/04/05 12:00	234.20	0.00	0.00	0.00	234.20	116.78	0.00	0.00	0.00	116.78
1	Locker Room	LR	327.45	327.45	0.00	0.00	0.00	10/21/05 8:34 AM	11/04/05 12:00	327.37	0.00	0.00	0.00	327.37	235.85	0.00	0.00	0.00	235.85
9	Restroom	R	324.90	324.90	0.00	0.00	0.00	10/21/05 11:07	11/04/05 12:00	164.45	0.00	0.00	0.00	164.45	51.13	0.00	0.00	0.00	51.13

All Loggers Listed			Load	Normalized Weekly Hours of Use					Normalized Weekly Hours of Occupancy					
Logger	Area Type	Ty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav
12	Open Office	OO	750	46.70	0.00	0.00	0.00	46.70	46.05	0.00	0.00	0.00	46.05	1.39%
11	Open Office	OO	1500	54.71	0.00	0.00	0.00	54.71	53.35	0.00	0.00	0.00	53.35	2.49%
24154	Kitchen	K	400	38.13	0.00	0.00	0.00	38.13	30.65	0.00	0.00	0.00	30.65	19.62%
5	Hallway	H	450	167.58	0.00	0.00	0.00	167.58	62.49	0.00	0.00	0.00	62.49	62.71%
6	Conference	CN	1800	21.69	0.00	0.00	0.00	21.69	17.96	0.00	0.00	0.00	17.96	17.20%
3	Conference	CN	0	9.19	0.00	0.00	0.00	9.19	8.47	0.00	0.00	0.00	8.47	7.83%
4	Conference	CN	0	81.69	0.00	0.00	0.00	81.69	64.93	0.00	0.00	0.00	64.93	20.52%
23194	Cafeteria	CF	1350	150.10	0.00	0.00	0.00	150.10	115.83	0.00	0.00	0.00	115.83	22.83%
13	Warehouse	W	2250	27.00	0.00	0.00	0.00	27.00	2.20	0.00	0.00	0.00	2.20	91.85%
10	Restroom	R	300	68.68	0.00	0.00	0.00	68.68	39.04	0.00	0.00	0.00	39.04	43.16%
24243	Restroom	R	600	168.00	0.00	0.00	0.00	168.00	104.61	0.00	0.00	0.00	104.61	37.73%
16	Warehouse	W	800	155.92	0.00	0.00	0.00	155.92	96.41	0.00	0.00	0.00	96.41	38.17%
14	Warehouse	W	4000	142.19	0.00	0.00	0.00	142.19	33.01	0.00	0.00	0.00	33.01	76.78%
15	Warehouse	W	1000	101.41	0.00	0.00	0.00	101.41	4.20	0.00	0.00	0.00	4.20	95.86%
8	Open Office	OO	1300	73.56	0.00	0.00	0.00	73.56	62.11	0.00	0.00	0.00	62.11	15.57%
7	Locker Room	LR	400	120.91	0.00	0.00	0.00	120.91	60.29	0.00	0.00	0.00	60.29	50.14%
1	Locker Room	LR	0	167.96	0.00	0.00	0.00	167.96	121.00	0.00	0.00	0.00	121.00	27.96%
9	Restroom	R	300	85.03	0.00	0.00	0.00	85.03	26.44	0.00	0.00	0.00	26.44	68.91%

Building Summary Totals				Lights On KwHR					Occupied KwHR				
Area Type		Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
Restroom	R	3	1200	129	0	0	0	129	68	0	0	0	68
Hallway	H	1	450	75	0	0	0	75	28	0	0	0	28
Kitchen	K	1	400	15	0	0	0	15	12	0	0	0	12
Locker Room	LR	2	400	58	0	0	0	58	36	0	0	0	36
Warehouse	W	4	8052	859	0	0	0	859	273	0	0	0	273
Cafeteria	CF	1	1350	203	0	0	0	203	156	0	0	0	156
Open Office	OO	3	3549	207	0	0	0	207	191	0	0	0	191
Conference	CN	3	1800	68	0	0	0	68	55	0	0	0	55
Building Totals			17201	1613	0			1613	820	0			820