


Area Type Averages

Building type:Industrial Manufacturing. Building size:250K to less than 500K. Shifts:3

Area Type Averages			Normalized Weekly Lights On					Normalized Weekly Occupied						
Area Type	Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav	
Private Office	PO	2	240	41.66	0.00	0.00	0.00	41.66	23.03	0.00	0.00	0.00	23.03	44.72%
Meeting Rooms	M	2	750	66.71	0.00	0.00	0.00	66.71	41.37	0.00	0.00	0.00	41.37	37.99%
Restroom	R	1	120	133.04	0.00	0.00	0.00	133.04	32.84	0.00	0.00	0.00	32.84	75.32%
Storage	S	1	840	168.00	0.00	0.00	0.00	168.00	58.52	0.00	0.00	0.00	58.52	65.17%
Hallway	H	2	406	166.11	0.00	0.00	0.00	166.11	61.81	0.00	0.00	0.00	61.81	62.79%
Lab	L	2	1980	65.85	0.00	0.00	0.00	65.85	28.52	0.00	0.00	0.00	28.52	56.69%
Warehouse	W	2	1080	165.14	0.00	0.00	0.00	165.14	22.31	0.00	0.00	0.00	22.31	86.49%
Factory	FA	2	1440	135.04	0.00	0.00	0.00	135.04	45.52	0.00	0.00	0.00	45.52	66.29%
Office	O	3	280	49.84	0.00	0.00	0.00	49.84	39.56	0.00	0.00	0.00	39.56	20.63%
Building Average			13592	107.44			0.00	107.44	36.92			0.00	36.92	65.64%

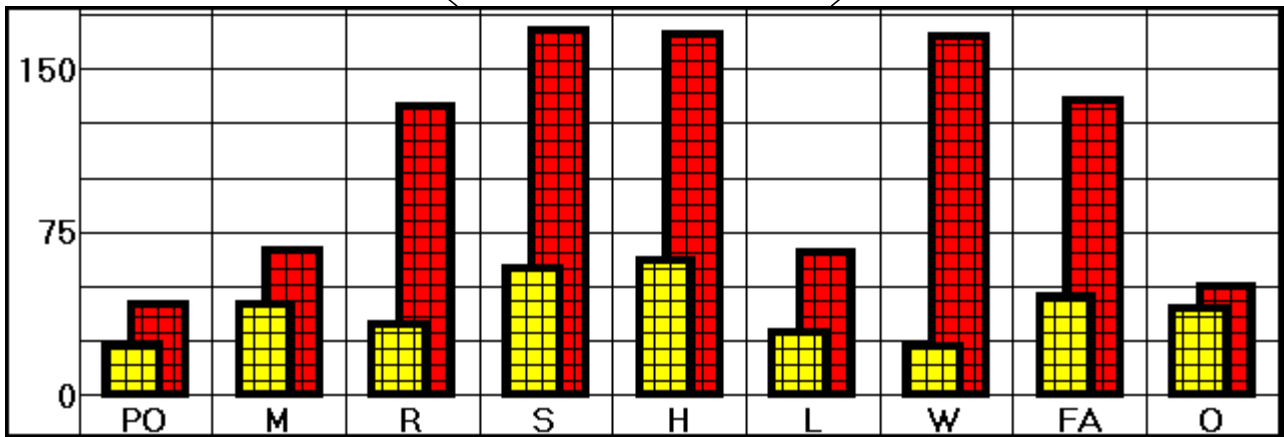

Hours per Week for each Area Type

Data Logger Detail Building type:Industrial Manufacturing. Building size:250K to less than 500K. Shifts:3 Page 1 of 1

All Loggers Listed			Hours Installed							Lights On					Occupied				
Logger	Area Type	Ty	Total	Peak	Off	Shldr 1	Shldr 2	Installed	Removed	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
20872	Storage	S	492.63	492.63	0.00	0.00	0.00	9/07/05 11:23 AM	9/28/05 12:00 AM	492.63	0.00	0.00	0.00	492.63	171.60	0.00	0.00	0.00	171.60
22167	Office	O	492.20	492.20	0.00	0.00	0.00	9/07/05 11:49 AM	9/28/05 12:00 AM	136.25	0.00	0.00	0.00	136.25	129.75	0.00	0.00	0.00	129.75
22705	Private Office	PO	491.85	491.85	0.00	0.00	0.00	9/07/05 12:10 PM	9/28/05 12:00 AM	122.40	0.00	0.00	0.00	122.40	65.80	0.00	0.00	0.00	65.80
21180	Private Office	PO	491.83	491.83	0.00	0.00	0.00	9/07/05 12:11 PM	9/28/05 12:00 AM	121.53	0.00	0.00	0.00	121.53	69.00	0.00	0.00	0.00	69.00
23149	Hallway	H	491.60	491.60	0.00	0.00	0.00	9/07/05 12:25 PM	9/28/05 12:00 AM	486.07	0.00	0.00	0.00	486.07	175.17	0.00	0.00	0.00	175.17
20939	Hallway	H	491.63	491.63	0.00	0.00	0.00	9/07/05 12:23 PM	9/28/05 12:00 AM	486.10	0.00	0.00	0.00	486.10	186.58	0.00	0.00	0.00	186.58
20499	Office	O	492.40	492.40	0.00	0.00	0.00	9/07/05 11:37 AM	9/28/05 12:00 AM	159.30	0.00	0.00	0.00	159.30	87.93	0.00	0.00	0.00	87.93
21048	Lab	L	491.92	491.92	0.00	0.00	0.00	9/07/05 12:06 PM	9/28/05 12:00 AM	76.97	0.00	0.00	0.00	76.97	69.37	0.00	0.00	0.00	69.37
21681	Lab	L	491.98	491.98	0.00	0.00	0.00	9/07/05 12:02 PM	9/28/05 12:00 AM	308.65	0.00	0.00	0.00	308.65	97.67	0.00	0.00	0.00	97.67
22254	Meeting Rooms	M	491.75	491.75	0.00	0.00	0.00	9/07/05 12:16 PM	9/28/05 12:00 AM	190.77	0.00	0.00	0.00	190.77	105.87	0.00	0.00	0.00	105.87
21020	Factory	FA	492.53	492.53	0.00	0.00	0.00	9/07/05 11:29 AM	9/28/05 12:00 AM	384.27	0.00	0.00	0.00	384.27	123.23	0.00	0.00	0.00	123.23
22165	Factory	FA	492.43	492.43	0.00	0.00	0.00	9/07/05 11:35 AM	9/28/05 12:00 AM	407.43	0.00	0.00	0.00	407.43	143.63	0.00	0.00	0.00	143.63
21625	Meeting Rooms	M	491.55	491.55	0.00	0.00	0.00	9/07/05 12:28 PM	9/28/05 12:00 AM	199.67	0.00	0.00	0.00	199.67	136.27	0.00	0.00	0.00	136.27
22183	Office	O	492.08	492.08	0.00	0.00	0.00	9/07/05 11:56 AM	9/28/05 12:00 AM	142.50	0.00	0.00	0.00	142.50	130.00	0.00	0.00	0.00	130.00
22077	Warehouse	W	492.33	492.33	0.00	0.00	0.00	9/07/05 11:41 AM	9/28/05 12:00 AM	483.97	0.00	0.00	0.00	483.97	73.90	0.00	0.00	0.00	73.90
21875	Warehouse	W	492.27	492.27	0.00	0.00	0.00	9/07/05 11:45 AM	9/28/05 12:00 AM	483.83	0.00	0.00	0.00	483.83	56.83	0.00	0.00	0.00	56.83
20665	Restroom	R	492.53	492.53	0.00	0.00	0.00	9/07/05 11:29 AM	9/28/05 12:00 AM	390.05	0.00	0.00	0.00	390.05	96.27	0.00	0.00	0.00	96.27

All Loggers Listed			Load	Normalized Weekly Hours of Use					Normalized Weekly Hours of Occupancy					
Logger	Area Type	Ty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav
20872	Storage	S	840	168.00	0.00	0.00	0.00	168.00	58.52	0.00	0.00	0.00	58.52	65.17%
22167	Office	O	300	46.51	0.00	0.00	0.00	46.51	44.29	0.00	0.00	0.00	44.29	4.77%
22705	Private Office	PO	240	41.81	0.00	0.00	0.00	41.81	22.48	0.00	0.00	0.00	22.48	46.23%
21180	Private Office	PO	240	41.51	0.00	0.00	0.00	41.51	23.57	0.00	0.00	0.00	23.57	43.22%
23149	Hallway	H	406	166.11	0.00	0.00	0.00	166.11	59.86	0.00	0.00	0.00	59.86	63.96%
20939	Hallway	H	406	166.11	0.00	0.00	0.00	166.11	63.76	0.00	0.00	0.00	63.76	61.62%
20499	Office	O	300	54.35	0.00	0.00	0.00	54.35	30.00	0.00	0.00	0.00	30.00	44.80%
21048	Lab	L	1980	26.29	0.00	0.00	0.00	26.29	23.69	0.00	0.00	0.00	23.69	9.89%
21681	Lab	L	1980	105.40	0.00	0.00	0.00	105.40	33.35	0.00	0.00	0.00	33.35	68.36%
22254	Meeting Rooms	M	1080	65.17	0.00	0.00	0.00	65.17	36.17	0.00	0.00	0.00	36.17	44.50%
21020	Factory	FA	1440	131.07	0.00	0.00	0.00	131.07	42.03	0.00	0.00	0.00	42.03	67.93%
22165	Factory	FA	1440	139.00	0.00	0.00	0.00	139.00	49.00	0.00	0.00	0.00	49.00	64.75%
21625	Meeting Rooms	M	420	68.24	0.00	0.00	0.00	68.24	46.57	0.00	0.00	0.00	46.57	31.76%
22183	Office	O	240	48.65	0.00	0.00	0.00	48.65	44.38	0.00	0.00	0.00	44.38	8.78%
22077	Warehouse	W	1080	165.15	0.00	0.00	0.00	165.15	25.22	0.00	0.00	0.00	25.22	84.73%
21875	Warehouse	W	1080	165.12	0.00	0.00	0.00	165.12	19.40	0.00	0.00	0.00	19.40	88.25%
20665	Restroom	R	120	133.04	0.00	0.00	0.00	133.04	32.84	0.00	0.00	0.00	32.84	75.32%

Building Summary Totals			Lights On KWHR						Occupied KWHR				
Area Type		Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
Private Office	PO	2	480	20	0	0	0	20	11	0	0	0	11
Meeting Rooms	M	2	1500	100	0	0	0	100	62	0	0	0	62
Restroom	R	1	120	16	0	0	0	16	4	0	0	0	4
Storage	S	1	840	141	0	0	0	141	49	0	0	0	49
Hallway	H	2	812	135	0	0	0	135	50	0	0	0	50
Lab	L	2	3960	261	0	0	0	261	113	0	0	0	113
Warehouse	W	2	2160	357	0	0	0	357	48	0	0	0	48
Factory	FA	2	2880	389	0	0	0	389	131	0	0	0	131
Office	O	3	840	42	0	0	0	42	33	0	0	0	33
Building Totals			13592	1460			0	1460	502			0	502