


# Area Type Averages

Building type:Light/High Tech Manufg. Building size:100K to less than 250K. Shifts:3

Area Type Averages				Normalized Weekly Lights On					Normalized Weekly Occupied					
Area Type	Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav	
Private Office	PO	3	140	77.90	0.00	0.00	77.90	26.27	0.00	0.00	0.00	26.27	66.28%	
Restroom	R	3	172	100.11	0.00	0.00	100.11	40.94	0.00	0.00	0.00	40.94	59.10%	
Storage	S	1	1080	167.99	0.00	0.00	167.99	69.84	0.00	0.00	0.00	69.84	58.43%	
Hallway	H	2	300	166.15	0.00	0.00	166.15	125.00	0.00	0.00	0.00	125.00	24.77%	
Lab	L	4	435	125.95	0.00	0.00	125.95	98.88	0.00	0.00	0.00	98.88	21.49%	
Mechanical Room /	MR	2	990	108.76	0.00	0.00	108.76	8.23	0.00	0.00	0.00	8.23	92.43%	
Warehouse	W	1	1920	85.76	0.00	0.00	85.76	47.09	0.00	0.00	0.00	47.09	45.09%	
Office	O	2	1152	91.89	0.00	0.00	91.89	47.27	0.00	0.00	0.00	47.27	48.56%	
Open Office	OO	2	360	142.19	0.00	0.00	142.19	64.70	0.00	0.00	0.00	64.70	54.50%	
Building Average			11280	113.36		0.00	113.36	54.68		0.00		54.68	51.76%	

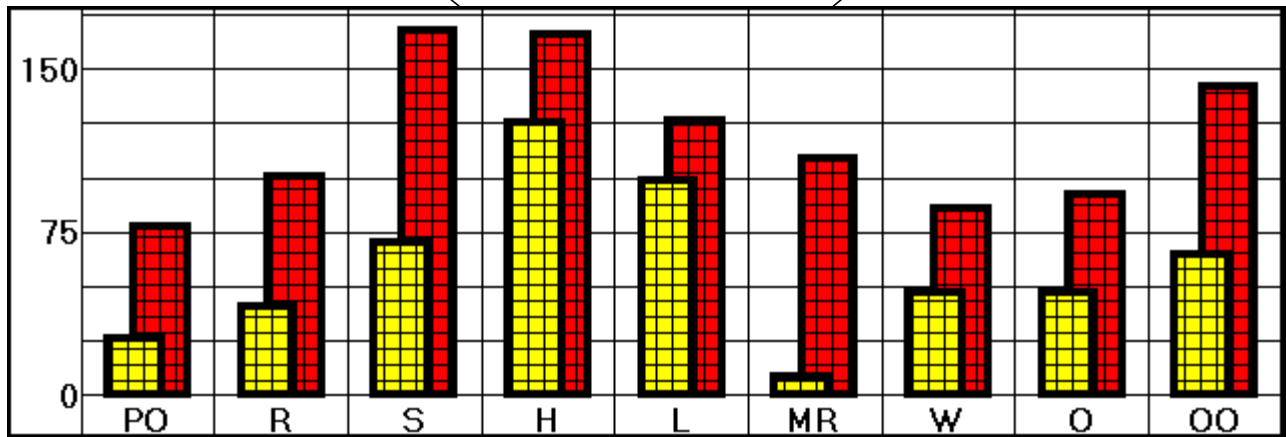

**Hours per Week for each Area Type**

Data Logger Detail Building type:Light/High Tech Manufg. Building size:100K to less than 250K. Shifts:3 Page 1 of 1

All Loggers Listed			Hours Installed							Lights On					Occupied				
Logger	Area Type	Ty	Total	Peak	Off	Shldr 1	Shldr 2	Installed	Removed	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
22297	Open Office	OO	337.32	337.32	0.00	0.00	0.00	10/14/05 11:39	10/28/05 12:57	337.30	0.00	0.00	0.00	337.30	132.83	0.00	0.00	0.00	132.83
22716	Lab	L	337.22	337.22	0.00	0.00	0.00	10/14/05 11:50	10/28/05 1:02 PM	195.77	0.00	0.00	0.00	195.77	181.77	0.00	0.00	0.00	181.77
23814	Lab	L	337.25	337.25	0.00	0.00	0.00	10/14/05 11:48	10/28/05 1:02 PM	337.23	0.00	0.00	0.00	337.23	195.50	0.00	0.00	0.00	195.50
22733	Open Office	OO	337.32	337.32	0.00	0.00	0.00	10/14/05 11:37	10/28/05 12:55	233.70	0.00	0.00	0.00	233.70	126.97	0.00	0.00	0.00	126.97
21981	Restroom	R	337.83	337.83	0.00	0.00	0.00	10/14/05 11:34	10/28/05 1:23 PM	85.30	0.00	0.00	0.00	85.30	67.13	0.00	0.00	0.00	67.13
21133	Hallway	H	336.97	336.97	0.00	0.00	0.00	10/14/05 12:02	10/28/05 12:59	329.55	0.00	0.00	0.00	329.55	245.28	0.00	0.00	0.00	245.28
22277	Hallway	H	336.90	336.90	0.00	0.00	0.00	10/14/05 12:05	10/28/05 12:58	336.88	0.00	0.00	0.00	336.88	256.08	0.00	0.00	0.00	256.08
20840	Restroom	R	337.40	337.40	0.00	0.00	0.00	10/14/05 11:28	10/28/05 12:51	246.83	0.00	0.00	0.00	246.83	179.60	0.00	0.00	0.00	179.60
20869	Restroom	R	337.37	337.37	0.00	0.00	0.00	10/14/05 11:30	10/28/05 12:51	271.12	0.00	0.00	0.00	271.12	0.00	0.00	0.00	0.00	0.00
23805	Private Office	PO	337.75	337.75	0.00	0.00	0.00	10/14/05 11:42	10/28/05 1:26 PM	56.87	0.00	0.00	0.00	56.87	53.90	0.00	0.00	0.00	53.90
21483	Lab	L	337.18	337.18	0.00	0.00	0.00	10/14/05 11:54	10/28/05 1:04 PM	239.13	0.00	0.00	0.00	239.13	208.17	0.00	0.00	0.00	208.17
21976	Lab	L	337.13	337.13	0.00	0.00	0.00	10/14/05 11:57	10/28/05 1:04 PM	239.08	0.00	0.00	0.00	239.08	208.43	0.00	0.00	0.00	208.43
22078	Private Office	PO	336.97	336.97	0.00	0.00	0.00	10/14/05 12:10	10/28/05 1:07 PM	75.08	0.00	0.00	0.00	75.08	54.58	0.00	0.00	0.00	54.58
21865	Private Office	PO	336.93	336.93	0.00	0.00	0.00	10/14/05 12:26	10/28/05 1:21 PM	336.92	0.00	0.00	0.00	336.92	49.70	0.00	0.00	0.00	49.70
22155	Storage	S	336.73	336.73	0.00	0.00	0.00	10/14/05 12:34	10/28/05 1:17 PM	336.72	0.00	0.00	0.00	336.72	139.98	0.00	0.00	0.00	139.98
21968	Warehouse	W	175.52	175.52	0.00	0.00	0.00	10/14/05 12:29	10/21/05 7:59 PM	89.60	0.00	0.00	0.00	89.60	49.20	0.00	0.00	0.00	49.20
21840	Mechanical Room / Storage	MR	336.90	336.90	0.00	0.00	0.00	10/14/05 12:19	10/28/05 1:12 PM	336.88	0.00	0.00	0.00	336.88	29.37	0.00	0.00	0.00	29.37
21763	Mechanical Room / Storage	MR	336.92	336.92	0.00	0.00	0.00	10/14/05 12:16	10/28/05 1:10 PM	99.33	0.00	0.00	0.00	99.33	3.63	0.00	0.00	0.00	3.63
20652	Office	O	337.30	337.30	0.00	0.00	0.00	10/14/05 11:18	10/28/05 12:35	180.58	0.00	0.00	0.00	180.58	103.45	0.00	0.00	0.00	103.45
23632	Office	O	337.35	337.35	0.00	0.00	0.00	10/14/05 11:16	10/28/05 12:36	188.43	0.00	0.00	0.00	188.43	86.37	0.00	0.00	0.00	86.37

All Loggers Listed			Load	Normalized Weekly Hours of Use					Normalized Weekly Hours of Occupancy					
Logger	Area Type	Ty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav
22297	Open Office	OO	360	167.99	0.00	0.00	0.00	167.99	66.16	0.00	0.00	0.00	66.16	60.62%
22716	Lab	L	420	97.53	0.00	0.00	0.00	97.53	90.56	0.00	0.00	0.00	90.56	7.15%
23814	Lab	L	420	167.99	0.00	0.00	0.00	167.99	97.39	0.00	0.00	0.00	97.39	42.03%
22733	Open Office	OO	360	116.39	0.00	0.00	0.00	116.39	63.24	0.00	0.00	0.00	63.24	45.67%
21981	Restroom	R	180	42.42	0.00	0.00	0.00	42.42	33.38	0.00	0.00	0.00	33.38	21.31%
21133	Hallway	H	300	164.30	0.00	0.00	0.00	164.30	122.29	0.00	0.00	0.00	122.29	25.57%
22277	Hallway	H	300	167.99	0.00	0.00	0.00	167.99	127.70	0.00	0.00	0.00	127.70	23.98%
20840	Restroom	R	120	122.90	0.00	0.00	0.00	122.90	89.43	0.00	0.00	0.00	89.43	27.23%
20869	Restroom	R	217	135.01	0.00	0.00	0.00	135.01	0.00	0.00	0.00	0.00	0.00	00.00%
23805	Private Office	PO	180	28.29	0.00	0.00	0.00	28.29	26.81	0.00	0.00	0.00	26.81	5.23%
21483	Lab	L	450	119.15	0.00	0.00	0.00	119.15	103.72	0.00	0.00	0.00	103.72	12.95%
21976	Lab	L	450	119.14	0.00	0.00	0.00	119.14	103.87	0.00	0.00	0.00	103.87	12.82%
22078	Private Office	PO	120	37.43	0.00	0.00	0.00	37.43	27.21	0.00	0.00	0.00	27.21	27.30%
21865	Private Office	PO	120	167.99	0.00	0.00	0.00	167.99	24.78	0.00	0.00	0.00	24.78	85.25%
22155	Storage	S	1080	167.99	0.00	0.00	0.00	167.99	69.84	0.00	0.00	0.00	69.84	58.43%
21968	Warehouse	W	1920	85.76	0.00	0.00	0.00	85.76	47.09	0.00	0.00	0.00	47.09	45.09%
21840	Mechanical	MR	720	167.99	0.00	0.00	0.00	167.99	14.64	0.00	0.00	0.00	14.64	91.29%
21763	Mechanical	MR	1260	49.53	0.00	0.00	0.00	49.53	1.81	0.00	0.00	0.00	1.81	96.35%
20652	Office	O	1152	89.94	0.00	0.00	0.00	89.94	51.53	0.00	0.00	0.00	51.53	42.71%
23632	Office	O	1152	93.84	0.00	0.00	0.00	93.84	43.01	0.00	0.00	0.00	43.01	54.17%

Building Summary Totals				Lights On KWHR					Occupied KWHR				
Area Type		Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
Private Office	PO	3	420	33	0	0	0	33	11	0	0	0	11
Restroom	R	3	516	52	0	0	0	52	21	0	0	0	21
Storage	S	1	1080	181	0	0	0	181	75	0	0	0	75
Hallway	H	2	600	100	0	0	0	100	75	0	0	0	75
Lab	L	4	1740	219	0	0	0	219	172	0	0	0	172
Mechanical Room /	MR	2	1980	215	0	0	0	215	16	0	0	0	16
Warehouse	W	1	1920	165	0	0	0	165	90	0	0	0	90
Office	O	2	2304	212	0	0	0	212	109	0	0	0	109
Open Office	OO	2	720	102	0	0	0	102	47	0	0	0	47
Building Totals			11280	1279	0			1279	617	0			617