


# Area Type Averages

Building type:Light/High Tech Manufg. Building size:250K to less than 500K. Shifts:3

Area Type Averages				Normalized Weekly Lights On					Normalized Weekly Occupied					
Area Type	Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav	
Restroom	R	2	100	80.33	0.00	0.00	80.33	40.26	0.00	0.00	0.00	40.26	49.88%	
Storage	S	3	100	80.43	0.00	0.00	80.43	15.54	0.00	0.00	0.00	15.54	80.68%	
Hallway	H	2	100	86.59	0.00	0.00	86.59	65.67	0.00	0.00	0.00	65.67	24.16%	
Office	O	5	100	60.73	0.00	0.00	60.73	40.66	0.00	0.00	0.00	40.66	33.05%	
Open Office	OO	1	100	67.77	0.00	0.00	67.77	64.52	0.00	0.00	0.00	64.52	4.80%	
Building Average			1300	72.81			72.81	40.48			0.00	40.48	44.40%	

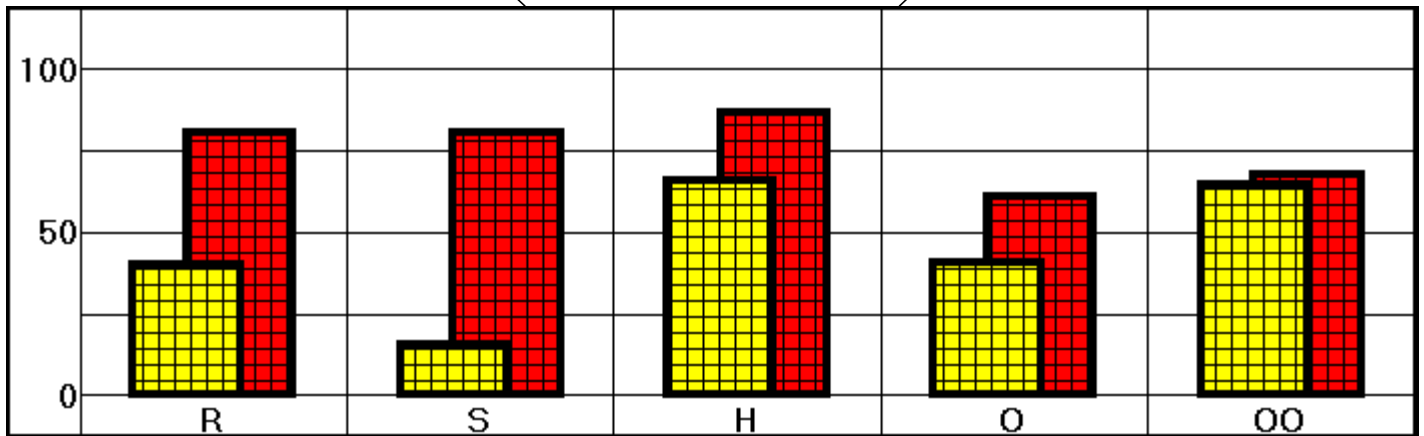

**Hours per Week for each Area Type**

Data Logger Detail Building type:Light/High Tech Manufg. Building size:250K to less than 500K. Shifts:3

All Loggers Listed			Hours Installed					Lights On					Occupied						
Logger	Area Type	Ty	Total	Peak	Off	Shldr 1	Shldr 2	Installed	Removed	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
20475	Restroom	R	240.98	240.98	0.00	0.00	0.00	10/18/05 2:53 PM	10/28/05 3:51 PM	6.60	0.00	0.00	0.00	6.60	5.67	0.00	0.00	0.00	5.67
20274	Office	O	241.00	241.00	0.00	0.00	0.00	10/18/05 2:43 PM	10/28/05 3:42 PM	47.42	0.00	0.00	0.00	47.42	42.88	0.00	0.00	0.00	42.88
20108	Office	O	242.57	242.57	0.00	0.00	0.00	10/18/05 12:49	10/28/05 3:22 PM	147.25	0.00	0.00	0.00	147.25	62.48	0.00	0.00	0.00	62.48
20067	Office	O	242.35	242.35	0.00	0.00	0.00	10/18/05 12:33	10/28/05 2:53 PM	159.27	0.00	0.00	0.00	159.27	144.50	0.00	0.00	0.00	144.50
20133	Hallway	H	243.15	243.15	0.00	0.00	0.00	10/18/05 12:22	10/28/05 3:30 PM	157.33	0.00	0.00	0.00	157.33	105.03	0.00	0.00	0.00	105.03
20097	Hallway	H	240.88	240.88	0.00	0.00	0.00	10/18/05 2:50 PM	10/28/05 3:42 PM	92.43	0.00	0.00	0.00	92.43	84.27	0.00	0.00	0.00	84.27
20062	Office	O	240.37	240.37	0.00	0.00	0.00	10/18/05 3:14 PM	10/28/05 3:35 PM	5.13	0.00	0.00	0.00	5.13	5.13	0.00	0.00	0.00	5.13
20085	Restroom	R	242.70	242.70	0.00	0.00	0.00	10/18/05 12:45	10/28/05 3:26 PM	225.45	0.00	0.00	0.00	225.45	110.62	0.00	0.00	0.00	110.62
20212	Storage	S	243.42	243.42	0.00	0.00	0.00	10/18/05 11:41	10/28/05 3:05 PM	108.93	0.00	0.00	0.00	108.93	41.40	0.00	0.00	0.00	41.40
20460	Open Office	OO	240.90	240.90	0.00	0.00	0.00	10/18/05 2:47 PM	10/28/05 3:40 PM	97.18	0.00	0.00	0.00	97.18	92.52	0.00	0.00	0.00	92.52
20176	Storage	S	228.12	228.12	0.00	0.00	0.00	10/19/05 2:51 AM	10/28/05 2:57 PM	1.37	0.00	0.00	0.00	1.37	0.00	0.00	0.00	0.00	0.00
20303	Storage	S	243.72	243.72	0.00	0.00	0.00	10/18/05 11:18	10/28/05 3:00 PM	239.50	0.00	0.00	0.00	239.50	26.17	0.00	0.00	0.00	26.17
20261	Office	O	242.12	242.12	0.00	0.00	0.00	10/18/05 1:03 PM	10/28/05 3:09 PM	78.73	0.00	0.00	0.00	78.73	38.00	0.00	0.00	0.00	38.00

Normalized Data Logger Detail Building type:Light/High Tech Manufg. Building size:250K to less than 500K. Shifts:3

All Loggers Listed			Load	Normalized Weekly Hours of Use					Normalized Weekly Hours of Occupancy					
Logger	Area Type	Ty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total	% sav
20475	Restroom	R	100	4.60	0.00	0.00	0.00	4.60	3.95	0.00	0.00	0.00	3.95	14.13%
20274	Office	O	100	33.05	0.00	0.00	0.00	33.05	29.89	0.00	0.00	0.00	29.89	9.56%
20108	Office	O	100	101.98	0.00	0.00	0.00	101.98	43.28	0.00	0.00	0.00	43.28	57.56%
20067	Office	O	100	110.41	0.00	0.00	0.00	110.41	100.17	0.00	0.00	0.00	100.17	9.27%
20133	Hallway	H	100	108.71	0.00	0.00	0.00	108.71	72.57	0.00	0.00	0.00	72.57	33.24%
20097	Hallway	H	100	64.47	0.00	0.00	0.00	64.47	58.77	0.00	0.00	0.00	58.77	8.84%
20062	Office	O	100	3.59	0.00	0.00	0.00	3.59	3.59	0.00	0.00	0.00	3.59	0.00%
20085	Restroom	R	100	156.06	0.00	0.00	0.00	156.06	76.57	0.00	0.00	0.00	76.57	50.94%
20212	Storage	S	100	75.18	0.00	0.00	0.00	75.18	28.57	0.00	0.00	0.00	28.57	62.00%
20460	Open Office	OO	100	67.77	0.00	0.00	0.00	67.77	64.52	0.00	0.00	0.00	64.52	4.80%
20176	Storage	S	100	1.01	0.00	0.00	0.00	1.01	0.00	0.00	0.00	0.00	0.00	00.00%
20303	Storage	S	100	165.09	0.00	0.00	0.00	165.09	18.04	0.00	0.00	0.00	18.04	89.07%
20261	Office	O	100	54.63	0.00	0.00	0.00	54.63	26.37	0.00	0.00	0.00	26.37	51.73%

Building Summary Totals Building type:Light/High Tech Manufg. Building size:250K to less than 500K. Shifts:3

Building Summary Totals				Lights On KWHR					Occupied KWHR				
Area Type		Qty	Watts	Peak	Off	Shldr 1	Shldr 2	Total	Peak	Off	Shldr 1	Shldr 2	Total
Restroom		R	2	200	16	0	0	16	8	0	0	0	8
Storage		S	3	300	24	0	0	24	5	0	0	0	5
Hallway		H	2	200	17	0	0	17	13	0	0	0	13
Office		O	5	500	30	0	0	30	20	0	0	0	20
Open Office		OO	1	100	7	0	0	7	6	0	0	0	6
Building Totals			1300	95	0	0	95	53	0	0	0	53	